

Information regarding CAEDA/Natrona County Community Studies

- CAEDA understands that these are “high-level” studies, and that electrical loads can and will change over time throughout Natrona County depending on growth patterns. It’s important that CAEDA stays in close contact with RMP as customers consider these areas.
- The 11 community studies highlight potential development areas and assist CAEDA in directing potential businesses to appropriate sites. At the point a business requires more specific information on electrical service costs, that business would then contact Rocky Mountain Power to proceed with the normal new connect process.
- Specifics for community studies:
 - Eleven “high-level” community studies will be developed for 11 different sites. Each community study:
 - Reviews 3 & 5 MW loads at each site.
 - Defines necessary distribution, substation and transmission construction for 3-phase primary to sites.
 - Is independent of each other.
 - Will be presented individually as completed.
 - All studies to be complete by January 1, 2014.
 - Studies do not consider service to more than one site.
 - If two or more sites are served from same substation, RMP will only consider work necessary to provide additional 3 & 5 MW.
 - Includes a unit cost to install pad-mounted equipment:
 - 3 MW load uses two 1500 kVA pad-mount transformer.
 - 5 MW load uses two 2500 kVA pad-mount transformers.
- Approximate cost of studies is \$50,000.

<i>Site Name</i>	<i>Priority</i>	<i>Name</i>	<i>Approximate Date</i>
Casper/Natrona County Intl Airport	1	Mike Anderson	8/22/2013
Bar Nunn	2	Frank Tomasini	8/1/2013
Robertson Road	3	Mike Anderson	9/12/2013
Amoco Rd & I-25	4	Frank Tomasini	9/18/2013
Salt Creek Heights	5	Mike Anderson	9/26/2013
Casper Events Center East	6	Mike Anderson	10/17/2013
Casper Substation North	7	Frank Tomasini	10/20/2013
New Industrial Area	8	Mike Anderson	10/31/2013
Evansville Industrial Park II	9	Mike Anderson	11/14/2013
Cole Creek Industrial Park	10	Mike Anderson	12/5/2013
C-Tran/Bishop Rail	11	Frank Tomasini	12/5/2013

Community Studies Report

Completed for:
CAEDA (Bar Nunn site)

Load:
3-5 MW

August 12, 2013

TABLE OF CONTENTS

1.0	DESCRIPTION OF REQUEST	2
2.0	SCOPE OF THE STUDY REPORT	3
3.0	DEFINITIONS.....	3
4.0	QUEUE ORDER	3
5.0	STUDY ASSUMPTIONS	3
6.0	CUSTOMER REQUIREMENTS.....	4
7.0	DISTRIBUTION STUDY RESULTS AND FACILITY REQUIREMENTS/COSTS (UN- SCOPED, BLOCK ESTIMATE)	6
8.0	TRANSMISSION STUDY RESULTS AND FACILITY REQUIREMENTS/COSTS (UN-SCOPED, BLOCK ESTIMATE)	6
9.0	CONCLUSIONS	6
10.0	PARTICIPATION BY AFFECTED SYSTEMS	7
	APPENDIX.....	I

1.0 Description of Request

CAEDA (Bar Nunn site) has requested a Community Study to identify system additions required to provide distribution level electrical service to a proposed new load in/near Bar Nunn, Wyoming. The interconnection is located at 42deg 56' 3.02" Latitude, -106deg 21' 31.98" Longitude.

Scenario 1: Customer's requested incremental and total load MW, voltage and schedule is shown in Table 1

	(kV)	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025
Existing Actual			-	-	-	-	-	-	-	-	-	-
Existing Contract												
New	0.48	3	0	0	0	0	0	0	0	0	0	0
Total	-	3	3	3	3	3	3	3	3	3	3	3

Table 1 – Ten Year Load Schedule

Scenario 2: Customer's requested incremental and total load MW, voltage and schedule is shown in Table 2

	(kV)	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025
Existing Actual			-	-	-	-	-	-	-	-	-	-
Existing Contract												
New	0.48	5	0	0	0	0	0	0	0	0	0	0
Total	-	5	5	5	5	5	5	5	5	5	5	5

Table 2 – Ten Year Load Schedule

A qualified representative for Customer has verified that the load forecast in Table 1 is the expected diversified peak demand.

2.0 Scope of the Study Report

This study evaluates Rocky Mountain Power's (Company) system to serve the load shown in Table 1.

- 2.1 This report assesses the reliability impact of the new facilities on the interconnected transmission systems to ensure compliance with NERC Reliability Standards and applicable regional, sub-regional, and Power Pool criteria and facility connection requirements.
- 2.2 This report provides a reasonable least cost solution to serve Customer's load.
- 2.3 This report includes un-scoped, estimated costs¹ to complete any required additions. More accurate estimates will be refined in later phases.
- 2.4 This report provides a statement about the feasibility of supporting Customer's requested load schedule. Customer shall not assume delivery dates from this report.
- 2.5 This report will address facilities which must be in service to meet Customer's requested load.
- 2.6 If applicable, this report will provide information for alternatives to serve Customer's load.

3.0 Definitions

- 3.1 "Adequate service" is defined as voltage levels identified in Rocky Mountain Power's existing Operability and Reliability Guidelines, filed with the applicable state regulators.
- 3.2 "N-0" refers to assessing the electrical systems without any outage conditions and all electrical network components in service and operating properly (steady state).
- 3.3 "N-1" refers to assessing the electrical systems with one component out of service.

4.0 Queue Order

This study is for informational purposes only. It is not treated as an official request and will not be entered into the existing load request queue. If CAEDA or a customer desires to move ahead with an official load request then a new request must be made and a new study will be completed at that time. No capacity has been reserved on the system at this time and other official requests that are received will be given priority in the order that those official requests are received.

5.0 Study Assumptions

Specific Assumptions for this queue request:

¹ Customer's financial responsibility for any required improvements to serve the load is beyond the scope of this report

- 5.1 This study was completed as a stand-alone, independent load and does not assume any of the other 10 CAEDA sites/loads were added to the system. Each CAEDA site is studied independently with its own load addition only.
- 5.2 Steady state and contingency conditions were studied as applicable. 2012 recorded loads were used as a basis with a 3.0% annual load growth applied, and applicable higher-priority service requests added to arrive at the base loads on which to add Customer's requested loads,
- 5.3 Customer will take 0.48-kV delivery from electrical service provider.
- 5.4 Customer will begin taking service as shown in Table 1 & 2.²
- 5.5 Study was performed with an assumed Customer total load power factor of 0.93.
Actual usage below the stated minimum power factor may invalidate the results of the study. Note: Customer may incur financial penalties for actual total load power factor below applicable state tariff.
- 5.6 This study assumes that the Bar Nunn 115-12.47 kV substation will be built and in service.

6.0 Customer Requirements

- 6.1.1 For transmission voltage delivery Customer shall provide adequate voltage regulation within their substation facilities to satisfy the Customer's load needs. Transmission system voltage under normal operating conditions may vary up to +6%/- 10%.
- 6.1.2 Customer's protection devices must coordinate with Rocky Mountain Power's protection devices.
- 6.1.3 Customer must follow PacifiCorp's "Customer Owned Substation Requirements."³
- 6.1.4 Customer is responsible to secure rights of way and/or permitting and pay associated costs for service extension facilities. This shall be done in coordination with and in a format acceptable to Company.
- 6.1.5 If Customer installs any on-site or backup generation, a "break-before-make" switch is required to be installed to prevent paralleling Customer's generation to Rocky Mountain Power's system. If Customer desires a "make-before-break", Customer must communicate this request in writing to PacifiCorp. Additional requirements will be required of Customer at their facility.
- 6.1.6 If Customer wishes to continue with this load request after receiving this report or any Company provided modification to this report, Customer must make this request in writing upon receipt per the terms of the ESA (typically 30 days) unless otherwise agreed to by Customer and Company to initiate the next phase of scoping, estimating

² This date is not a guarantee and is subject to project parameters and timely decision making of all parties involved. The service dates will be refined further in future phases of the project.

³ Available upon request.

and/or detail design. Failure to initiate request will result in Customer's removal from queue.

6.2 Power Quality and Reliability:

- 6.2.1 It is Customer's responsibility to adequately plan and mitigate any impacts due to outages and sags as a result of being connected to Company's power network.
- 6.2.2 Customer's three phase loads shall be reasonably balanced among the three phases.⁴
- 6.2.3 Customer facility shall meet all distortion requirements⁵ described in Company's Engineering Handbook.
- 6.2.4 Customer facility shall meet all induced voltage fluctuation and light flicker requirements⁶ described in Company's Engineering Handbook.
- 6.2.5 Customer must complete, with the help of a qualified engineer, the Power Quality and Reliability questionnaire attached in Appendix prior to Company proceeding to scope the selected option.

⁴ Used to maintain voltage balance within conditions described in Company's Engineering Handbook section 1C.3.1 found at <http://www.rockymountainpower.net/con/pqs.html>

⁵ Company's Engineering Handbook section 1C.4.1 found at <http://www.rockymountainpower.net/con/pqs.html>

⁶ Company's Engineering Handbook section 1C.5.1 found at <http://www.rockymountainpower.net/con/pqs.html> (and IEEE 1453-2011, Appendix F)

7.0 Distribution Study Results and Facility Requirements/Costs (Un-scoped, block estimate)

7.1 Scenario 1: Provide 3MW, 480Y/277 volt delivery from the 2015 proposed Bar Nunn 115–12.47 kV substation and feeder. (\$145,000 Un-Scoped estimate) See appendix Figure 1

- 7.1.1 Build 1,150 ft. of 3ph 4/0 AAC tap to Customer Site
- 7.1.2 Install two 1,500 kVA padmount transformers
- 7.1.3 Install two risers with 100T fuses
- 7.1.4 Install two 200ft of #2 Al-3ph cables to each transformer
- 7.1.5 Replace recloser 5H179 with a 3ph group operated switch 3479/294600, normal open point between Bar Nunn and Casper subs

7.2 Scenario 2: Provide 5 MW, 480Y/277 volt delivery from the 2015 proposed Bar Nunn 115–12.47 kV substation and feeder. (\$200,000 Un-Scoped estimate) See appendix Figure 1

- 7.2.1 Build 1,150 ft. of 3ph 4/0 AAC tap to Customer Site
- 7.2.2 Install two 2,500 kVA padmount transformers
- 7.2.3 Install two risers with 140T fuses
- 7.2.4 Install two 200ft of #4/0 Al-3ph cables to each transformer
- 7.2.5 Replace recloser 5H179 with a 3ph group operated switch 3479/294600, normal open point between Bar Nunn and Casper subs

8.0 Transmission Study Results and Facility Requirements/Costs (Un-scoped, block estimate)

8.1 No Transmission or Substation construction required.

9.0 Conclusions

9.1 Load Service Feasibility

It is anticipated Customer's requested load service can be accommodated by the addition of the improvements indicated in Section 7 and/or Section 8 of this report.

9.2 Delivery of Improvements Schedule Evaluation

- 9.2.1 Company estimates it will require approximately 6 months to provide the interconnection and system facilities:
 - 9.2.1.1 After the date Customer provides needed permits and rights of way for the interconnection facilities. Company estimates that the permitting and right of way function completed by Customer may take up to 3 years or more and could be a prerequisite to Company performing detail design.
 - 9.2.1.2 After Customer and Company execute required contracts to allow the project to proceed to design and order long lead material.

9.2.1.3 After Customer has provided necessary infrastructure per state tariff (such as vaults, trenching, conduit etc.)

9.3 Company anticipates Customer's requested schedule for service is feasible. A more accurate evaluation of the schedule will be developed in the next phase and the delivery schedule is subject to timely decision making and progress by all parties and activities.

9.4 It is estimated based on preliminary data that motor(s) operated by Customer will result in acceptable induced voltage fluctuations on the system per the guideline in Company's Engineering Handbook section 1C.5.1. This does not guarantee adherence to the requirements and actual motor characteristics such as "locked rotor" current shall be obtained and provided to Company for detailed assessment. System susceptibility to voltage fluctuation is subject to change and it shall be Customer's responsibility to ensure their facility meets all induced voltage fluctuation and light flicker requirements.

9.5 A motor start voltage fluctuation analysis will need to be performed once customer load had been identified.

10.0 Participation by Affected Systems

N/A

APPENDIX

I. Engineering Services Agreement (ESA) Information Form Loads and Sites

EXHIBIT A

SCOPE OF WORK


The Casper Area Economic Development Alliance (CAEDA) would like studies completed for 11 locations to get an idea of unscoped cost estimates to serve distribution loads in these areas.

Rocky Mountain Power will study distribution load additions of 3 MW and 5 MW at 11 different locations in Natrona County, WY for the customer and provide a system impact study for each location.

Site Name	Latitude	Longitude	T&R	Section
(1) Casper/Natr County Intl. Airport	42°53'38.64"	106°27'16.58"	T34N R80W	S21 SWSW
(2) Bar Nunn	42°56'3.02" N	106°21'31.98" W	T34N R79W	S7 NENE
(3) Robertson Road	42°51'17.35" N	106°25'4.91" W	T33N R80W	S3 NESE
(4) Amoco Road and I-25	42°53'0.30" N	106°20'20.63" W	T34N R79W	S29 NESE
(5) Salt Creek Heights	42°51'42.72" N	106°21'21.31" W	T33N R79W	S5 NWNW
(6) Casper Events Center East	42°52'12.52" N	106°19'17.23" W	T34N R79W	S33 NESE
(7) Casper Substation North	42°52'30.69" N	106°21'45.10" W	T34N R79W	S31 NWNE
(8) New Industrial Area	42°50'38.23" N	106°15'6.57" W	T33N R78W	S7 SESW
(9) Evansville Industrial Park II	42°51'18.55" N	106°15'30.12" W	T33N R78W	S6 NWSW
(10) Cole Creek Industrial Park	42°51'24.66" N	106°12'58.62" W	T33N R78W	S4 NWSW
(11) C-Tran/Bishop	42°55'52.05" N	106°26'34.73" W	T34N R80W	S9 SWNE

II. Maps/sketches

Figure 1 – Service to 3 or 5 MW CAEDA Bar Nunn site loads from 2015 proposed Bar Nunn substation and feeder

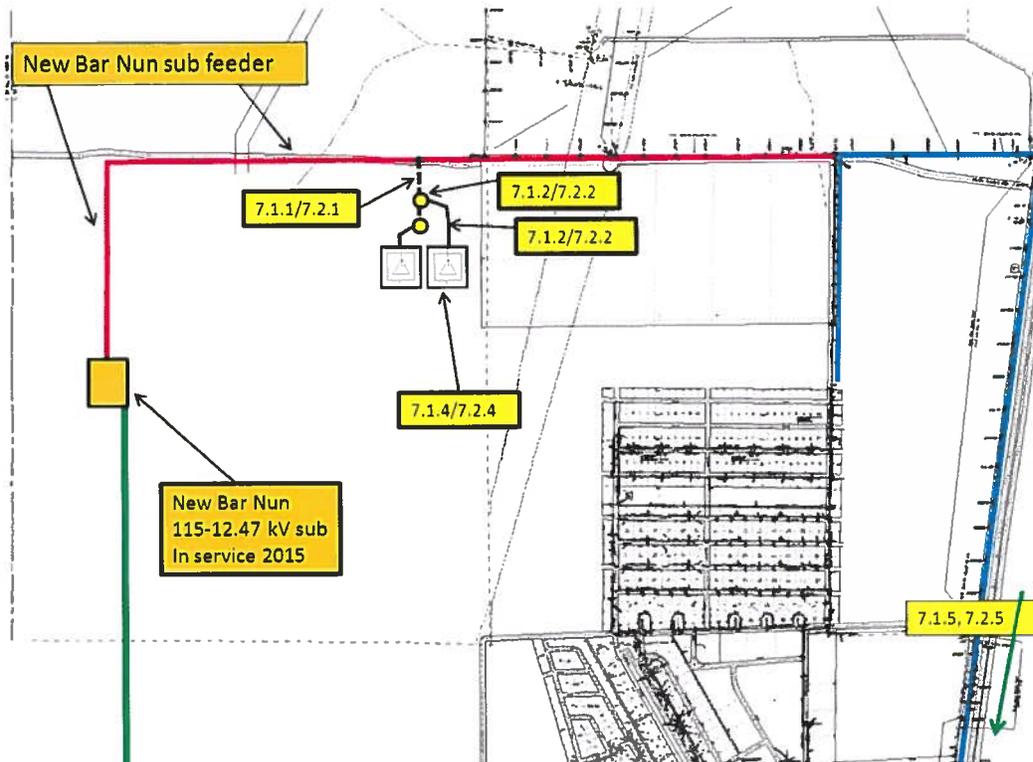

7.1 Scenario 1: Provide 3MW, 480Y/277 volt delivery from the 2015 proposed Bar Nunn 115–12.47 kV substation and feeder. (\$145,000 Un-Scoped estimate) See appendix Figure 1

- 7.1.1 Build 1,150 ft. of 3ph 4/0 AAC tap to Customer Site
- 7.1.2 Install two 1,500 kVA padmount transformers
- 7.1.3 Install two risers with 100T fuses
- 7.1.4 Install two 200ft of #2 Al-3ph cables to each transformer
- 7.1.5 Replace recloser 5H179 with a 3ph group operated switch 3479/294600, normal open point between Bar Nunn and Casper subs

7.2 Scenario 2: Provide 5 MW, 480Y/277 volt delivery from the 2015 proposed Bar Nunn 115–12.47 kV substation and feeder. (\$200,000 Un-Scoped estimate) See appendix Figure 1

- 7.2.1 Build 1,150 ft. of 3ph 4/0 AAC tap to Customer Site
- 7.2.2 Install two 2,500 kVA padmount transformers
- 7.2.3 Install two risers with 140T fuses
- 7.2.4 Install two 200ft of #4/0 Al-3ph cables to each transformer
- 7.2.5 Replace recloser 5H179 with a 3ph group operated switch 3479/294600, normal open point between Bar Nunn and Casper subs

POWER QUALITY AND RELIABILITY QUESTIONNAIRE

The following questions address the reality that events (such as lightning, vehicle accidents, etc.) will happen to disturb the normal flow of power to the facility resulting in voltage sags and spikes and/or interruptions. The best time to address these issues is at the planning/design stage. *An electrical supply system designed to provide higher-than-normal levels of reliability and quality will likely cost more. This added cost is born by Customer and will not prevent all disturbances from occurring. Customers are encouraged to design their end use to be more resilient to disturbances, and usually the cost to do this is less expensive than if the utility designs this resiliency into the electric supply system.*

Availability of Facility: _____

(How many minutes of interrupted power can the facility withstand per year? How long can an interruption last before unacceptable consequences are experienced by the facility?)

Sensitivity to Steady-state Voltage Variations: _____

(Describe how tight the voltage range needs to be for successful operation of this facility. Typical is +/- 5%)

Sensitivity to Voltage Disturbances: _____

(The most common disturbance is voltage sag due to unavoidable and temporary short circuits on nearby lines. These are usually very short, but can sometimes last up to a few seconds. Describe your facility's sensitivity to these events.)

Sensitivity to Voltage Distortion or Other Abnormalities: _____

(Occasionally a facility requires extremely pure power. Please describe any other needs in this regard.)

Electrical Pollution

It is now quite common for facilities to have equipment that can pollute the power if not properly specified or controlled. This includes variable frequency drives (VFDs), large motors without proper starters, induction heaters, and highly fluctuating loads such as welders and other arc producing devices. PacifiCorp has standards governing the pollution such equipment might introduce into its power system so that other customers are not adversely impacted. The following questions address these issues. Please state both size and type.

Highly Fluctuating Load: _____

(Describe any large (>10 kVA or 10 hp) equipment that will suddenly change from one load level to another. This includes motors—both starting and running loads, welders, arc-producers, X-ray machines, wood chippers, etc. If any of these large loads will be changing more often than once per day, state how often it will change.)

Harmonics-producing Load: _____

(Describe any large (>10 kVA or 10 hp) equipment that will produce harmonic distortion. This includes VFDs and rectifiers; also include aggregate loads such as percent of facility load that consists of VFDs if more than 10 %.)

Other Unusual Load or Equipment: _____

(Sometimes equipment works in ways that we don't expect. For example, induction heaters are very different from resistance heaters in that they can cause "notches" or pulsing in the supplied voltage. Any such equipment should be listed here. Also include any special mitigating equipment that will be installed such as a Static VAR Compensator—SVC.)

Power Factor (PF) Correction and Filters: _____

(Sometimes PF correction capacitors are added to a facility with VFDs or other harmonic load. This often leads to failed capacitors and other problems. Please state the size of PF correction capacitors and location if more than 150 kVAr.)

-- Submit Completed Form to RMP Power Quality and Reliability Engineer --